

YTC

DM+DBP

113

118

115

BYTD

114

DBP

2

117

2.01

$150\text{m}^3/\text{h}$

2.03

$\phi 200$

$\phi 125$

$\phi 160$

$\phi 100$

3.01

B

125

B

3

0


250

$250\text{m}^3/\text{h}$

DIGESTOŘ A PŘIPOJENÍ
DODÁVKA KLIENTA

ODVOD
KONDENZÁTU

ODVOD
KONDENZÁTU

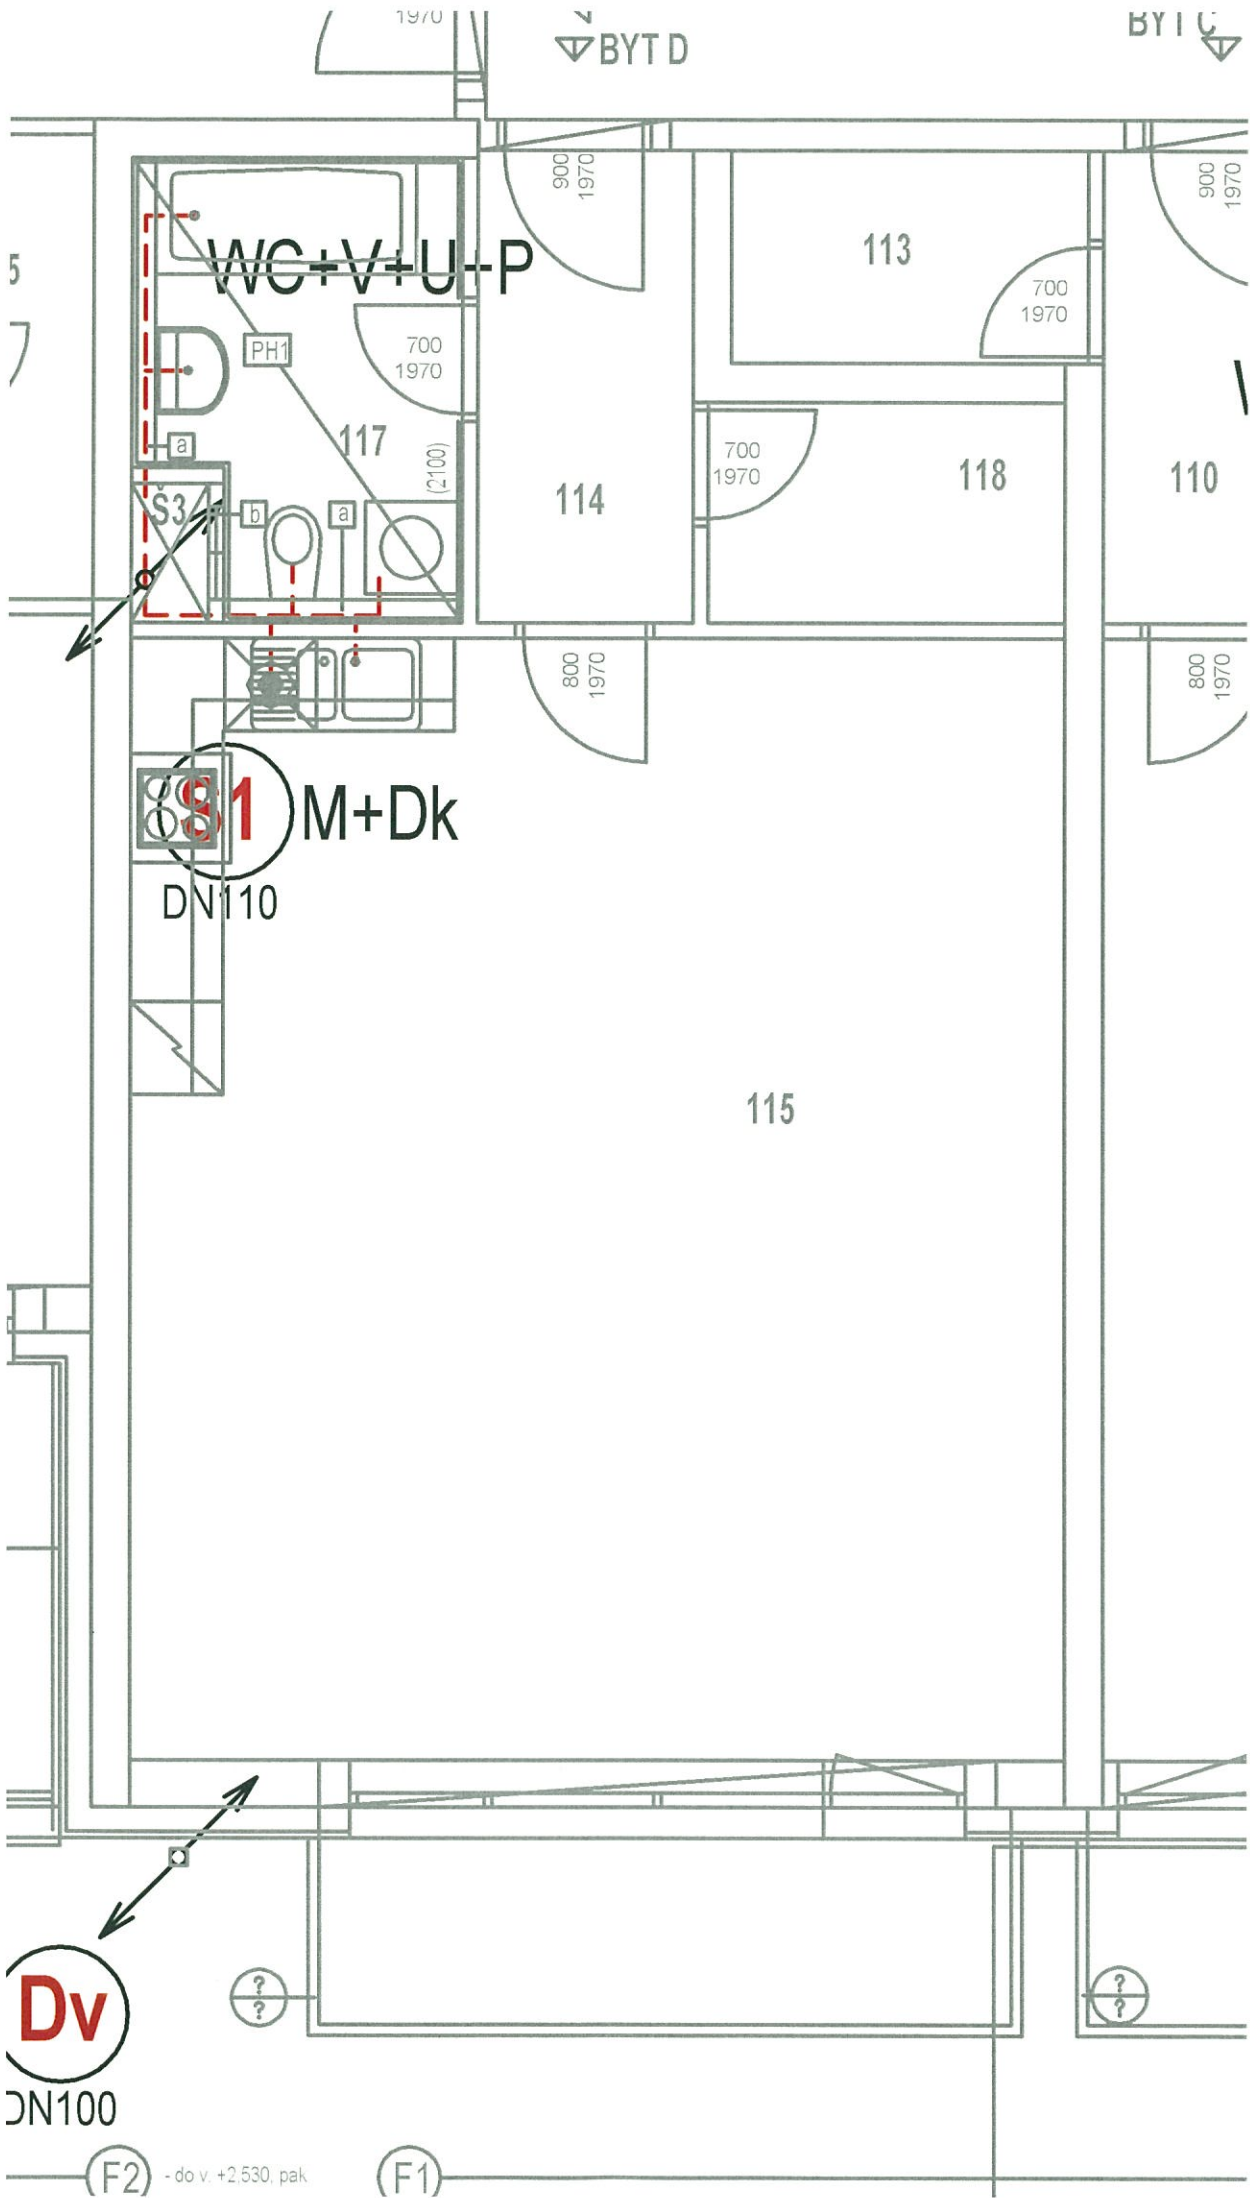


Dv
DN100

(F2) - do v. +2,530, pak

(F1)

BYT D

BYT C

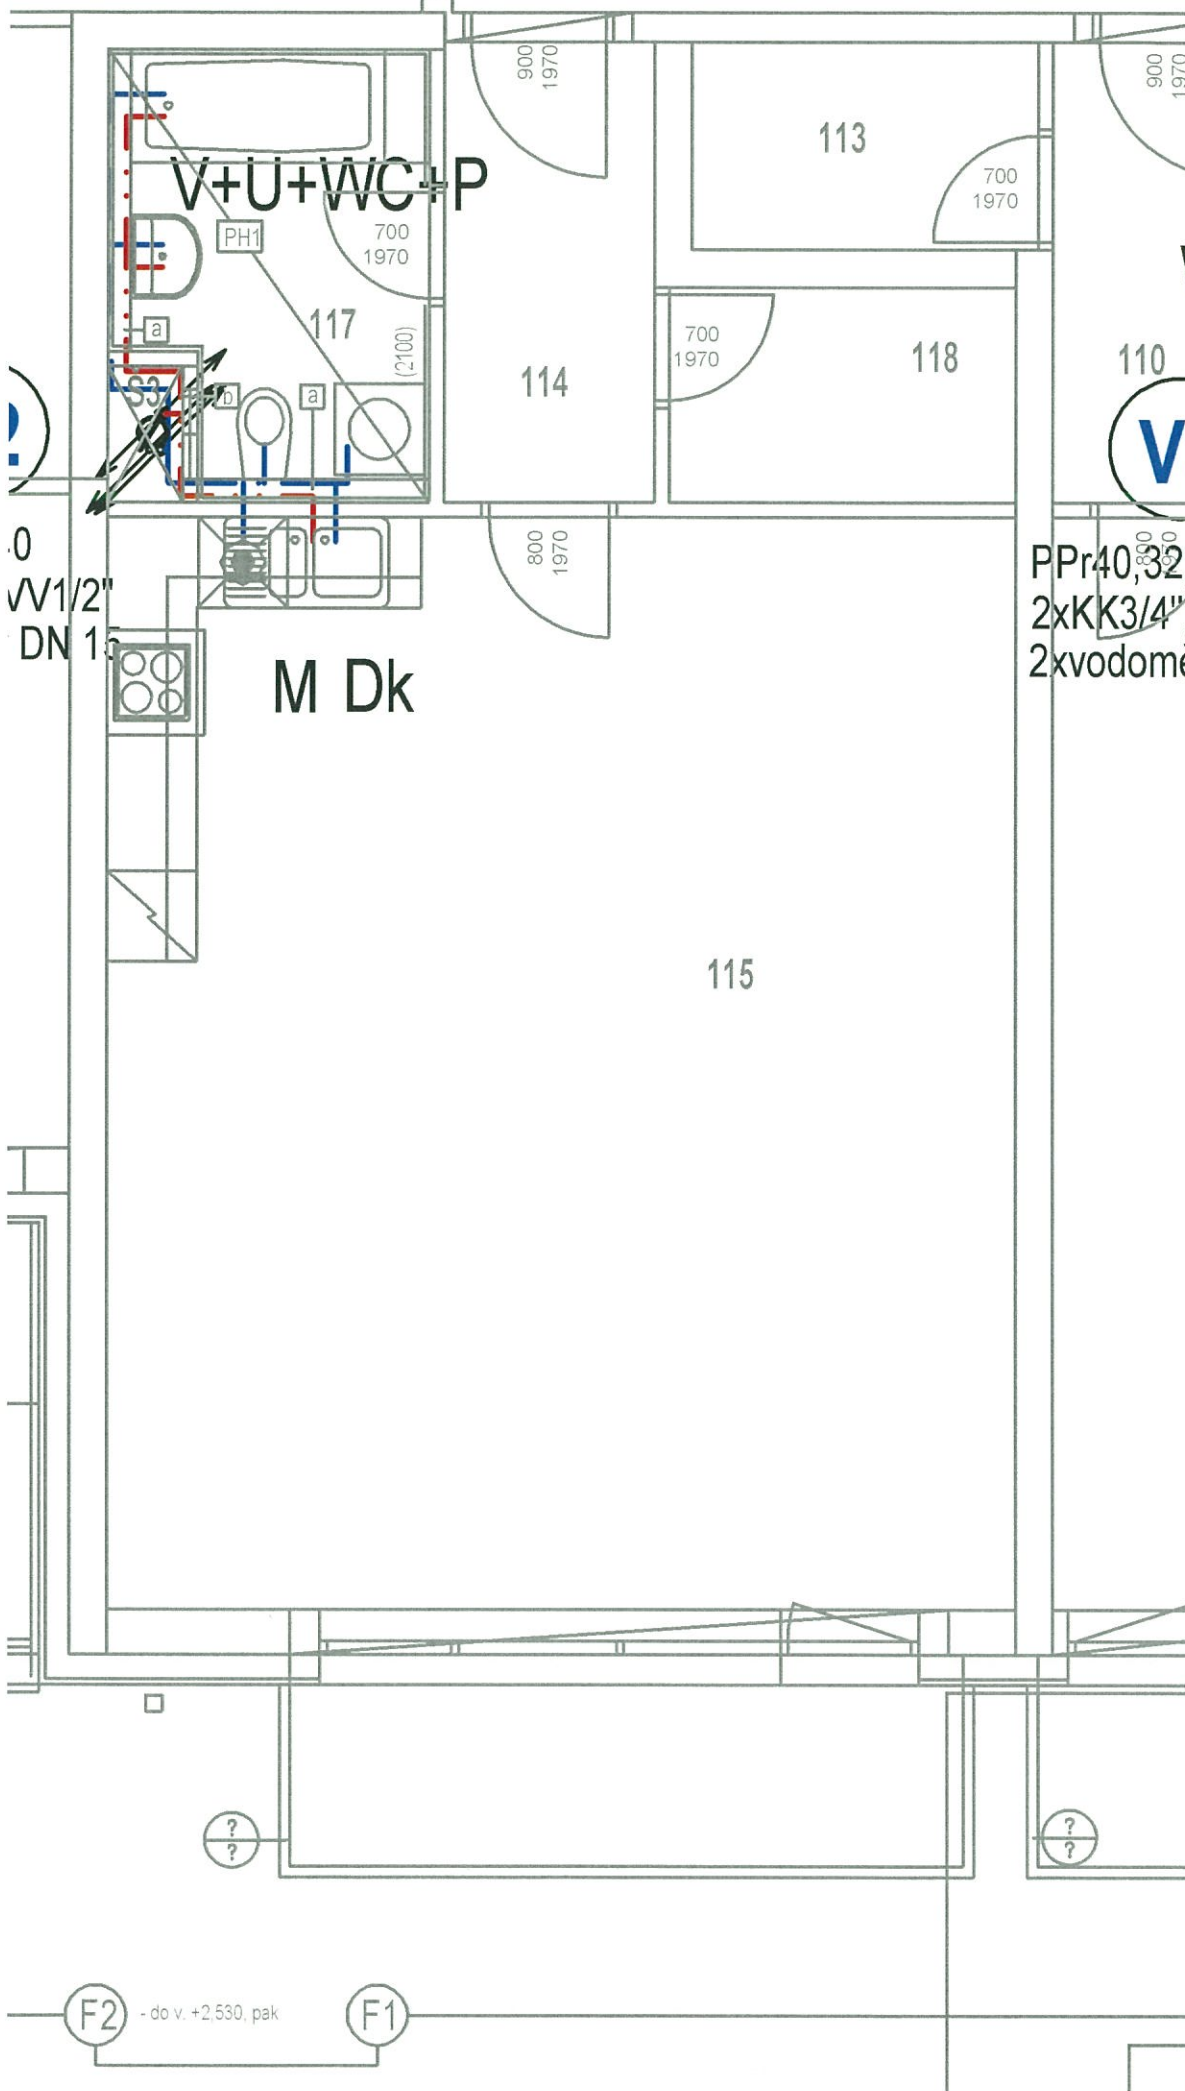

V+U+WC+P

PH1

a

117

(2'100)

114

700
1970

118

110

V

0
√V1/2"
DN 15

M Dk

PPr40,32,
2xKK3/4",
2xvodomě

115

F2

- do v. +2.530, pak

F1

?

?